

June 23, 2026**Addendum No. 04****File Reference Number: RFP 2026 031****Title: Cochrane Station Parking Lot Paving****RE: Additional work and clarification**

CLARIFICATIONS/QUESTIONS:

Item 1: Would the current 1200 mm diameter structure comply, given that OPSD 701.021 limits the maximum pipe opening size for a 90-degree connection to 700 mm, while the OD of an HDPE storm sewer pipe is approximately 711 mm (depending on the manufacturer), requiring an even larger opening?

Answer: ONTC understands that the connection exceeds 90 degrees, which provides some flexibility, and that most pre-cast structure suppliers should be able to accommodate the required opening. While OPSD 701.021 outlines maximum pipe opening sizes, it is noted that strict adherence is more critical for sanitary structures due to the presence of channels.

From a structural perspective, the slight increase in opening size is not expected to impact the integrity of the structure. Should any manufacturer be unable to accommodate the requirement, we can consider upsizing the CBMH to a 1500 mm diameter.

Item 2: Appendix H – Issue for Tender Drawings

Please find attached the Additional Ramp Drawings at the end of this Addendum.

Item 3: Addendum No. 03 – Item No. 03

Please be advised that ONTC has revised its response to the above-referenced item as follows:

Kindly note this revision supersedes any prior communication on this item.



Answer: After further investigation and internal discussion the testing is required and must be documented as stated in the RFP package even if we are moving the material with our own property. The contractor is to comply with all Environmental Laws in disposing of the waste products, debris and Excess Soil resulting from the Work.

Proponents must refer to Div 01 - 01 35 43, Item 1.08 Excess Soil Management for the details in the RFP package.

This Addendum hereby forms part of the RFP.

Regards,






Brinda Ranpura
Procurement Contracts Specialist
brinda.ranpura@ontarionorthland.ca

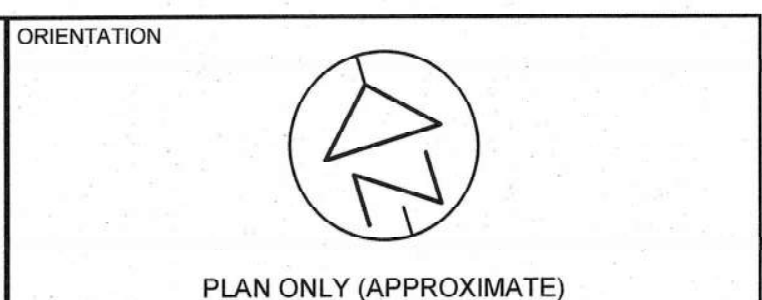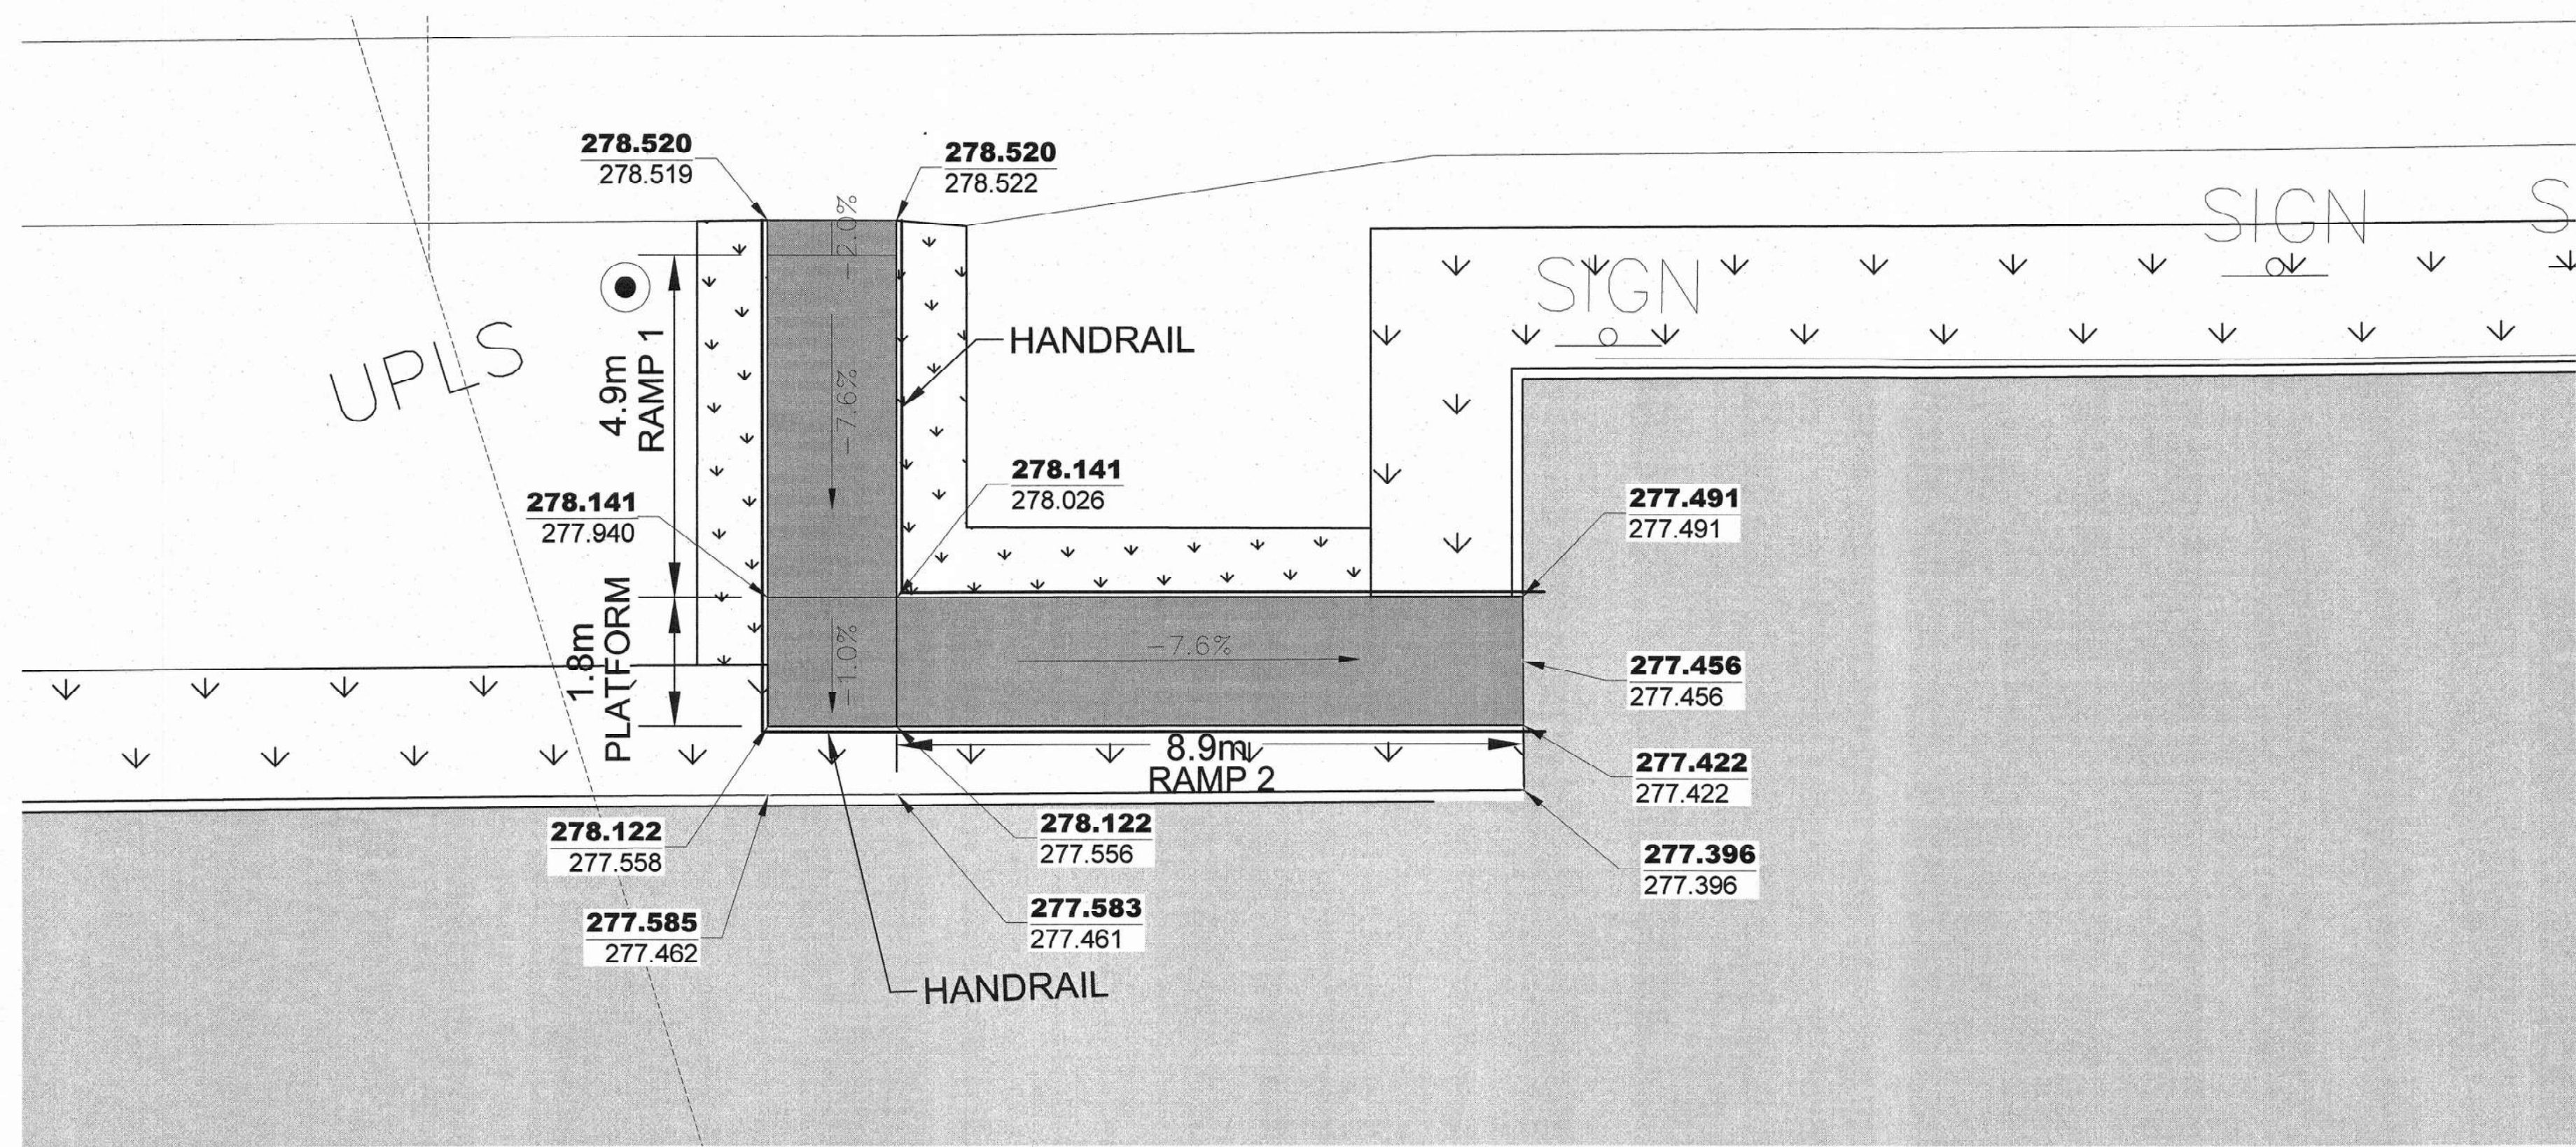

CAUTION: DO NOT SCALE DRAWINGS. THIS REPRODUCTION MAY BE AT A SIZE DIFFERENT THAN ORIGINALLY DRAWN. EXP ASSUMES NO RESPONSIBILITY FOR INCORRECT SCALING. UNAUTHORIZED REPRODUCTION OR REUSE IS STRICTLY PROHIBITED. NOT PUBLISHED - ALL RIGHTS RESERVED. EXP EXPRESSLY DISCLAIMS RESPONSIBILITY ARISING FROM UNAUTHORIZED USE OF THESE DRAWINGS AND NOTES. AUTHORIZATION MUST BE IN WRITING.
© exp, 2026

DIMENSIONS NOTES:
1. ALL DIMENSIONS ARE IN METERS (m) UNLESS NOTED OTHERWISE.

- NOTES:
1. NOT WITHSTANDING WHAT IS SHOWN HEREON, THE LOCATION OF ALL UTILITIES ARE TO BE DETERMINED BY THE CONTRACTOR PRIOR TO COMMENCING CONSTRUCTION.
 2. SITE SURVEY COMPLETED BY SURVEYORS ON SITE INC. AND PROVIDED TO EXP BY THE ONTC.
 3. CONTRACTOR TO SUBMIT SHOP DRAWING FOR HANDRAIL FOR APPROVAL.

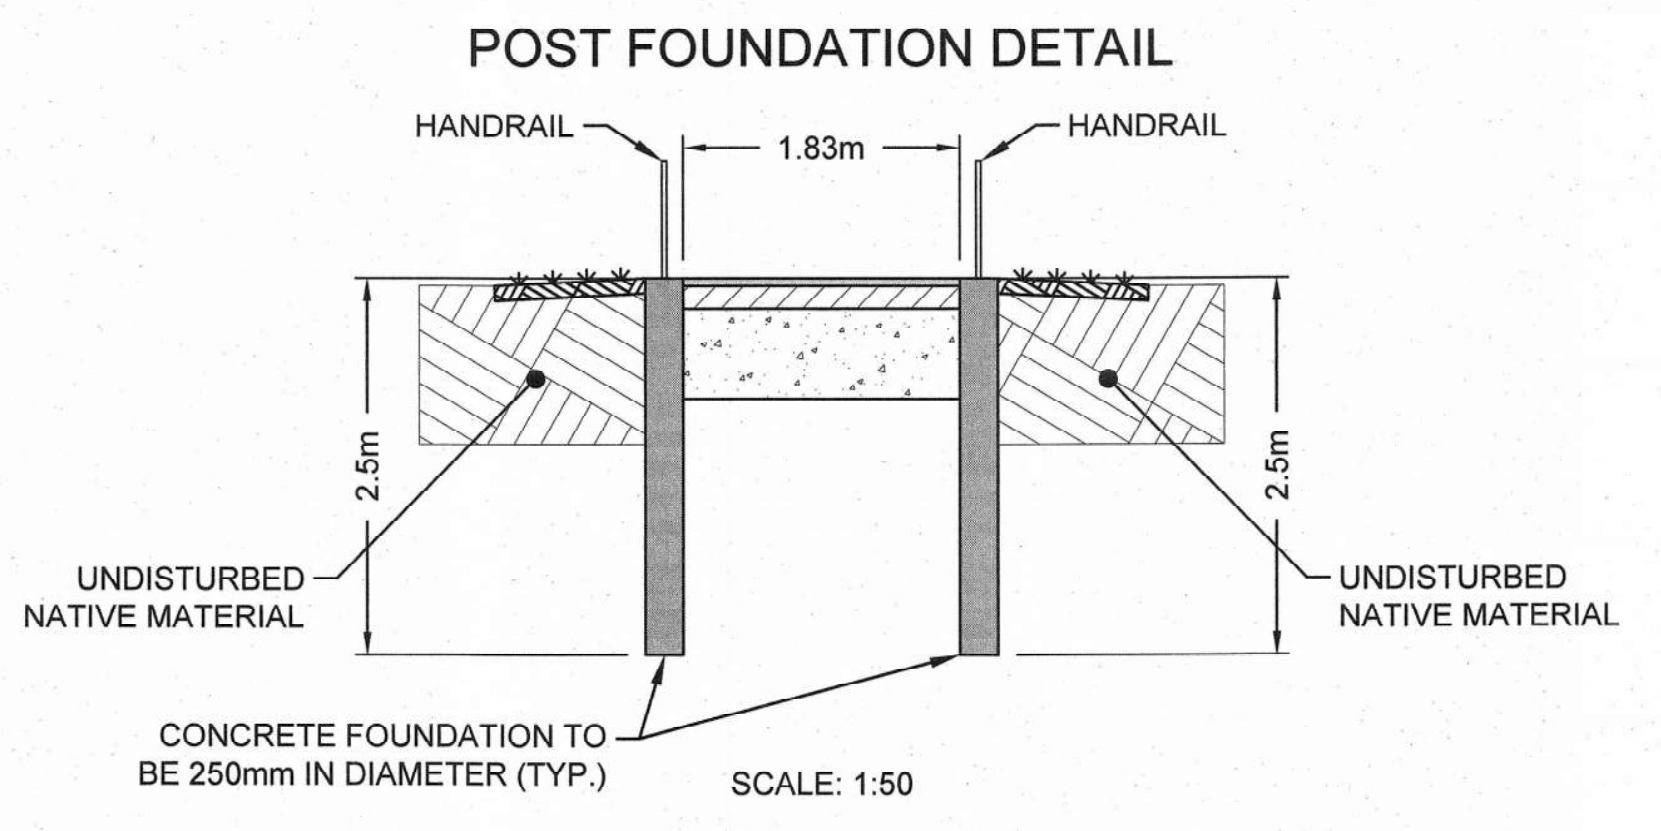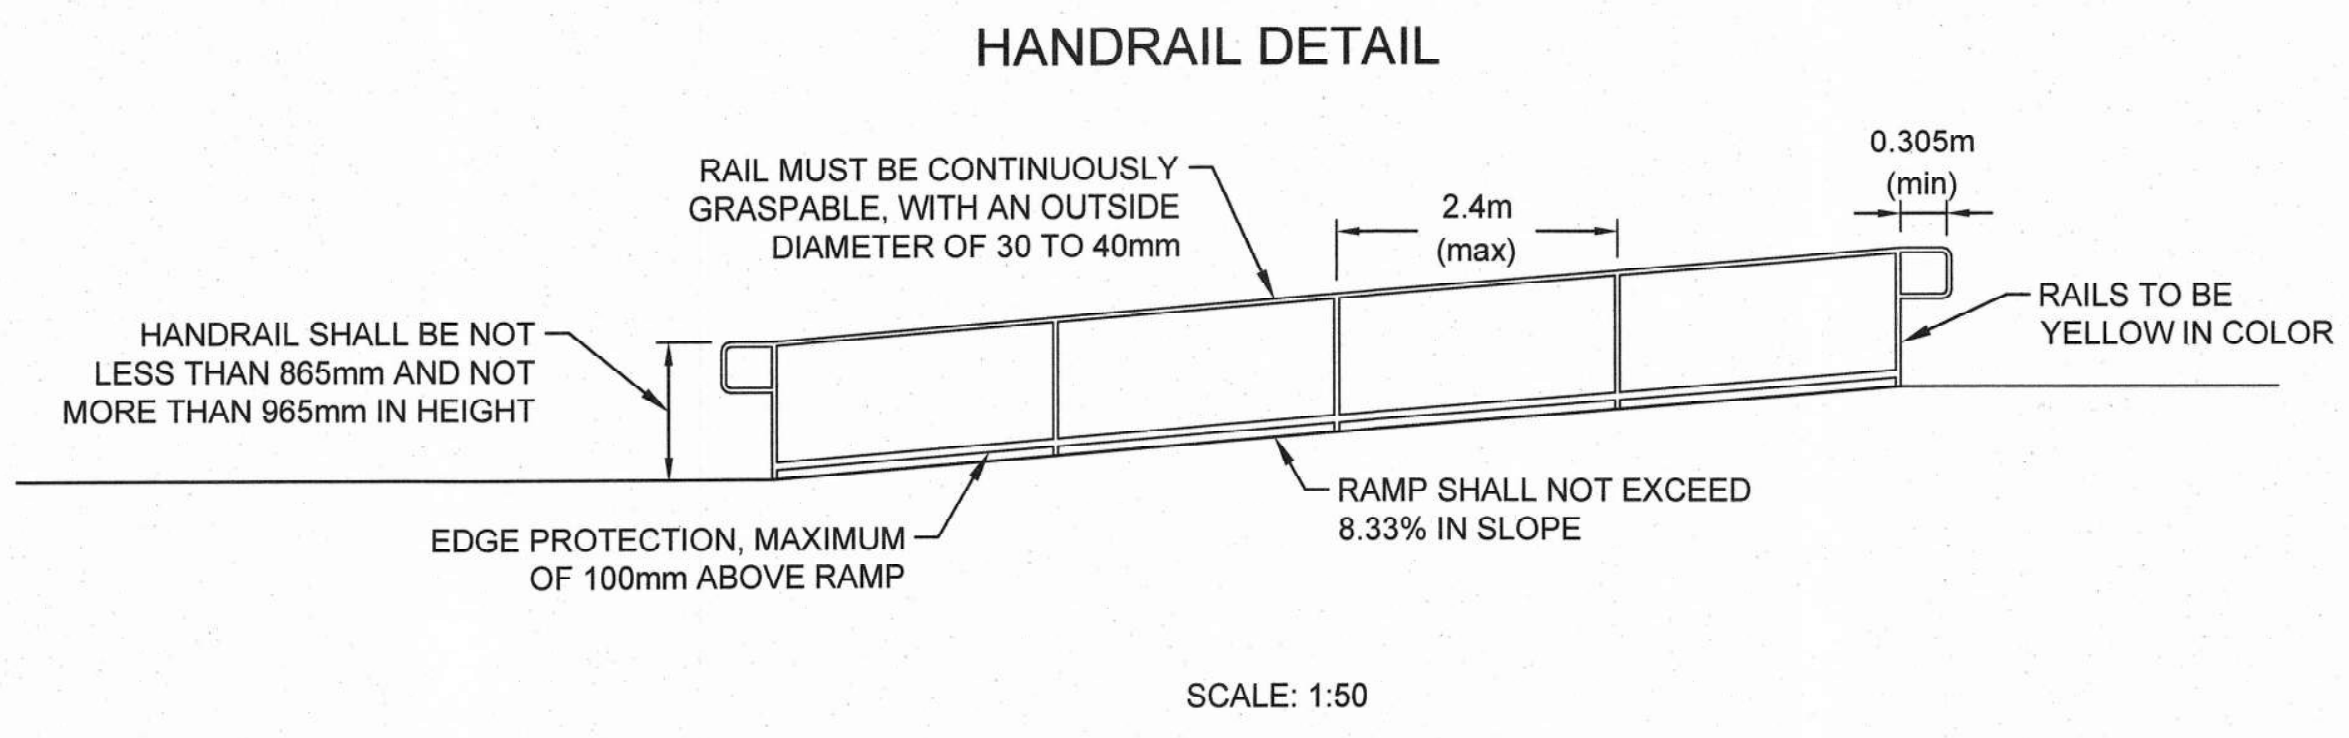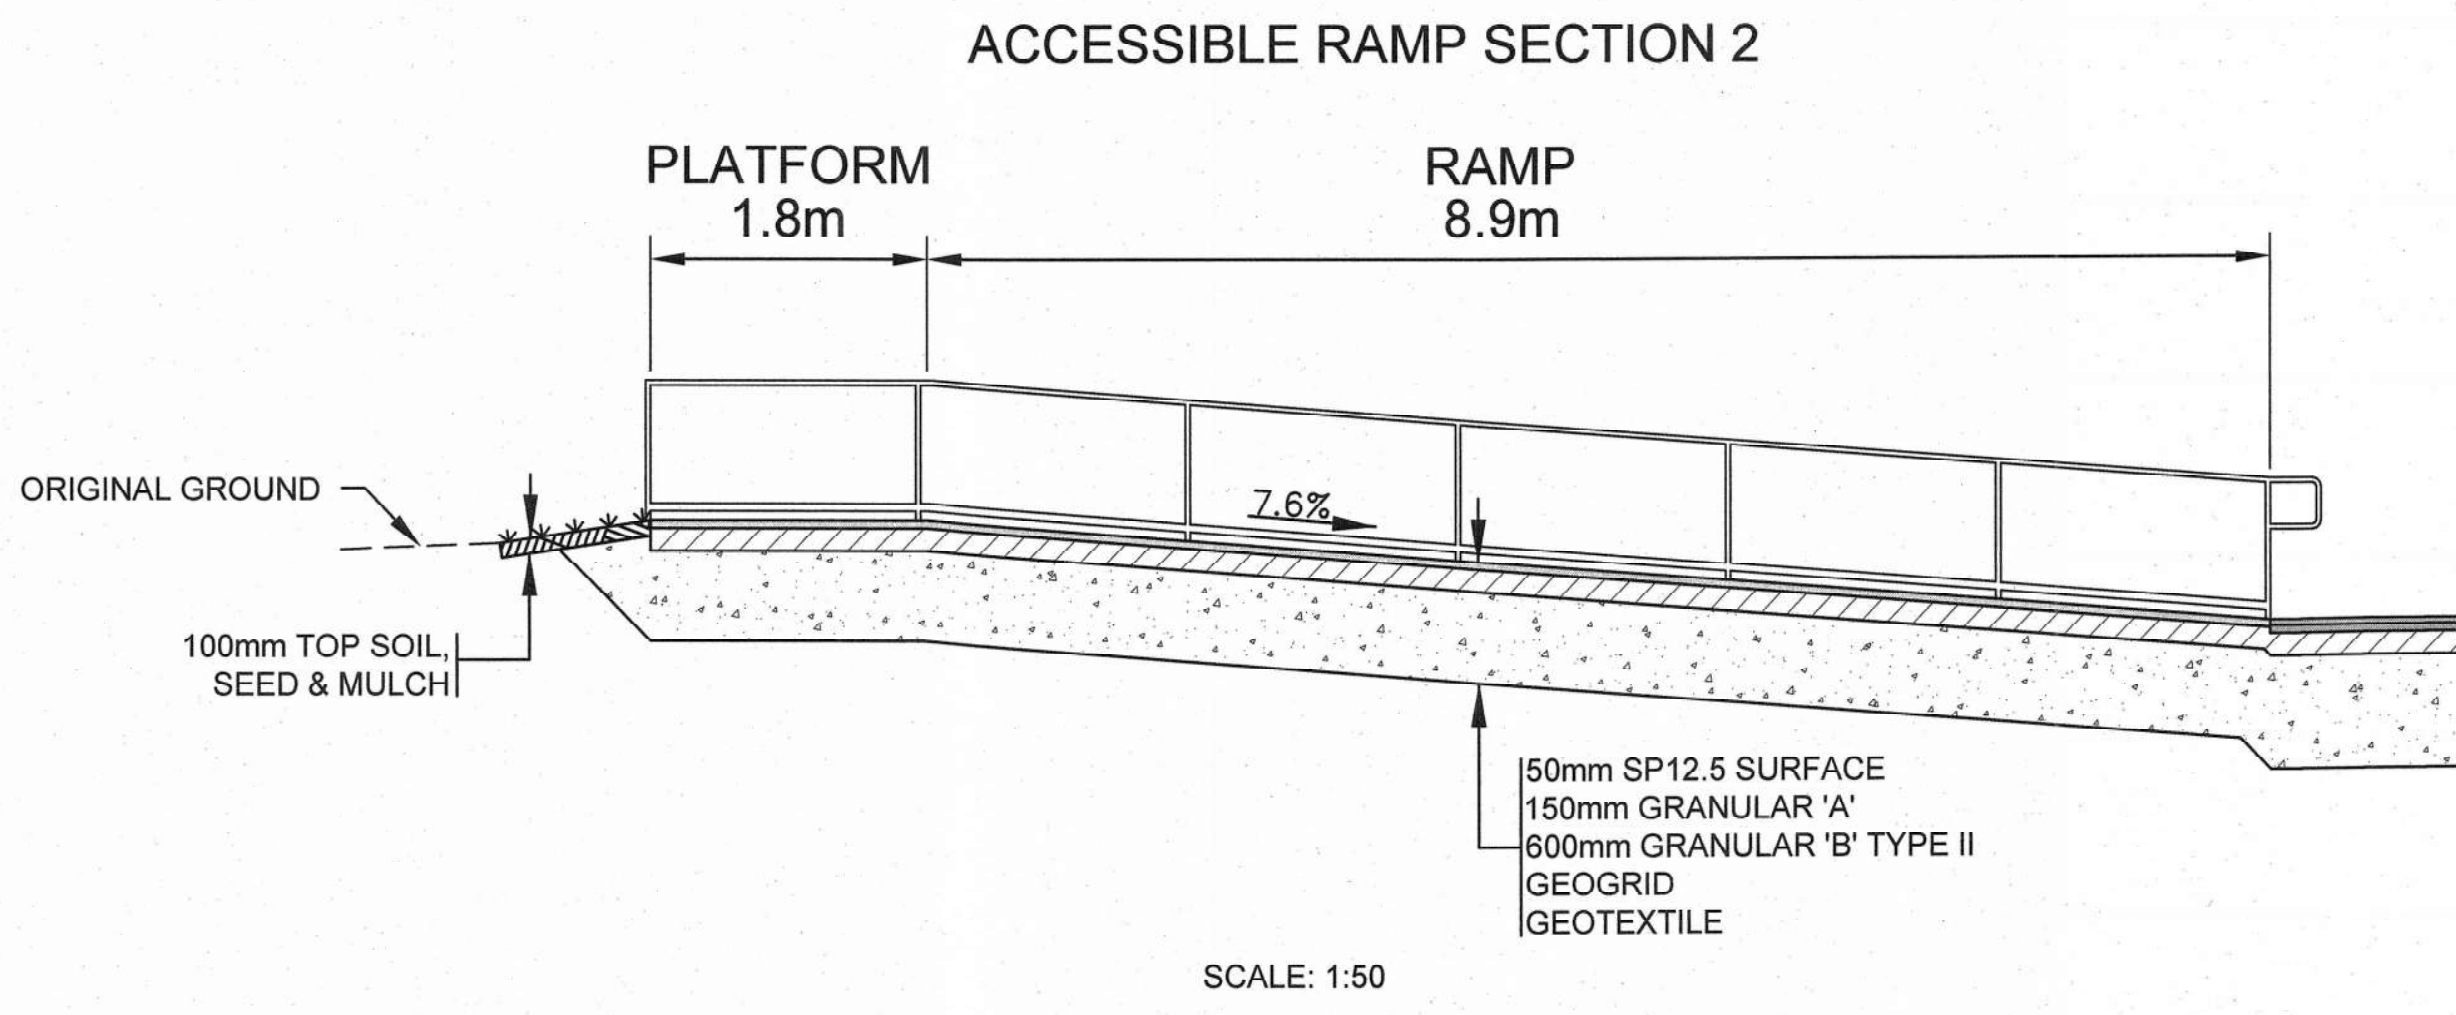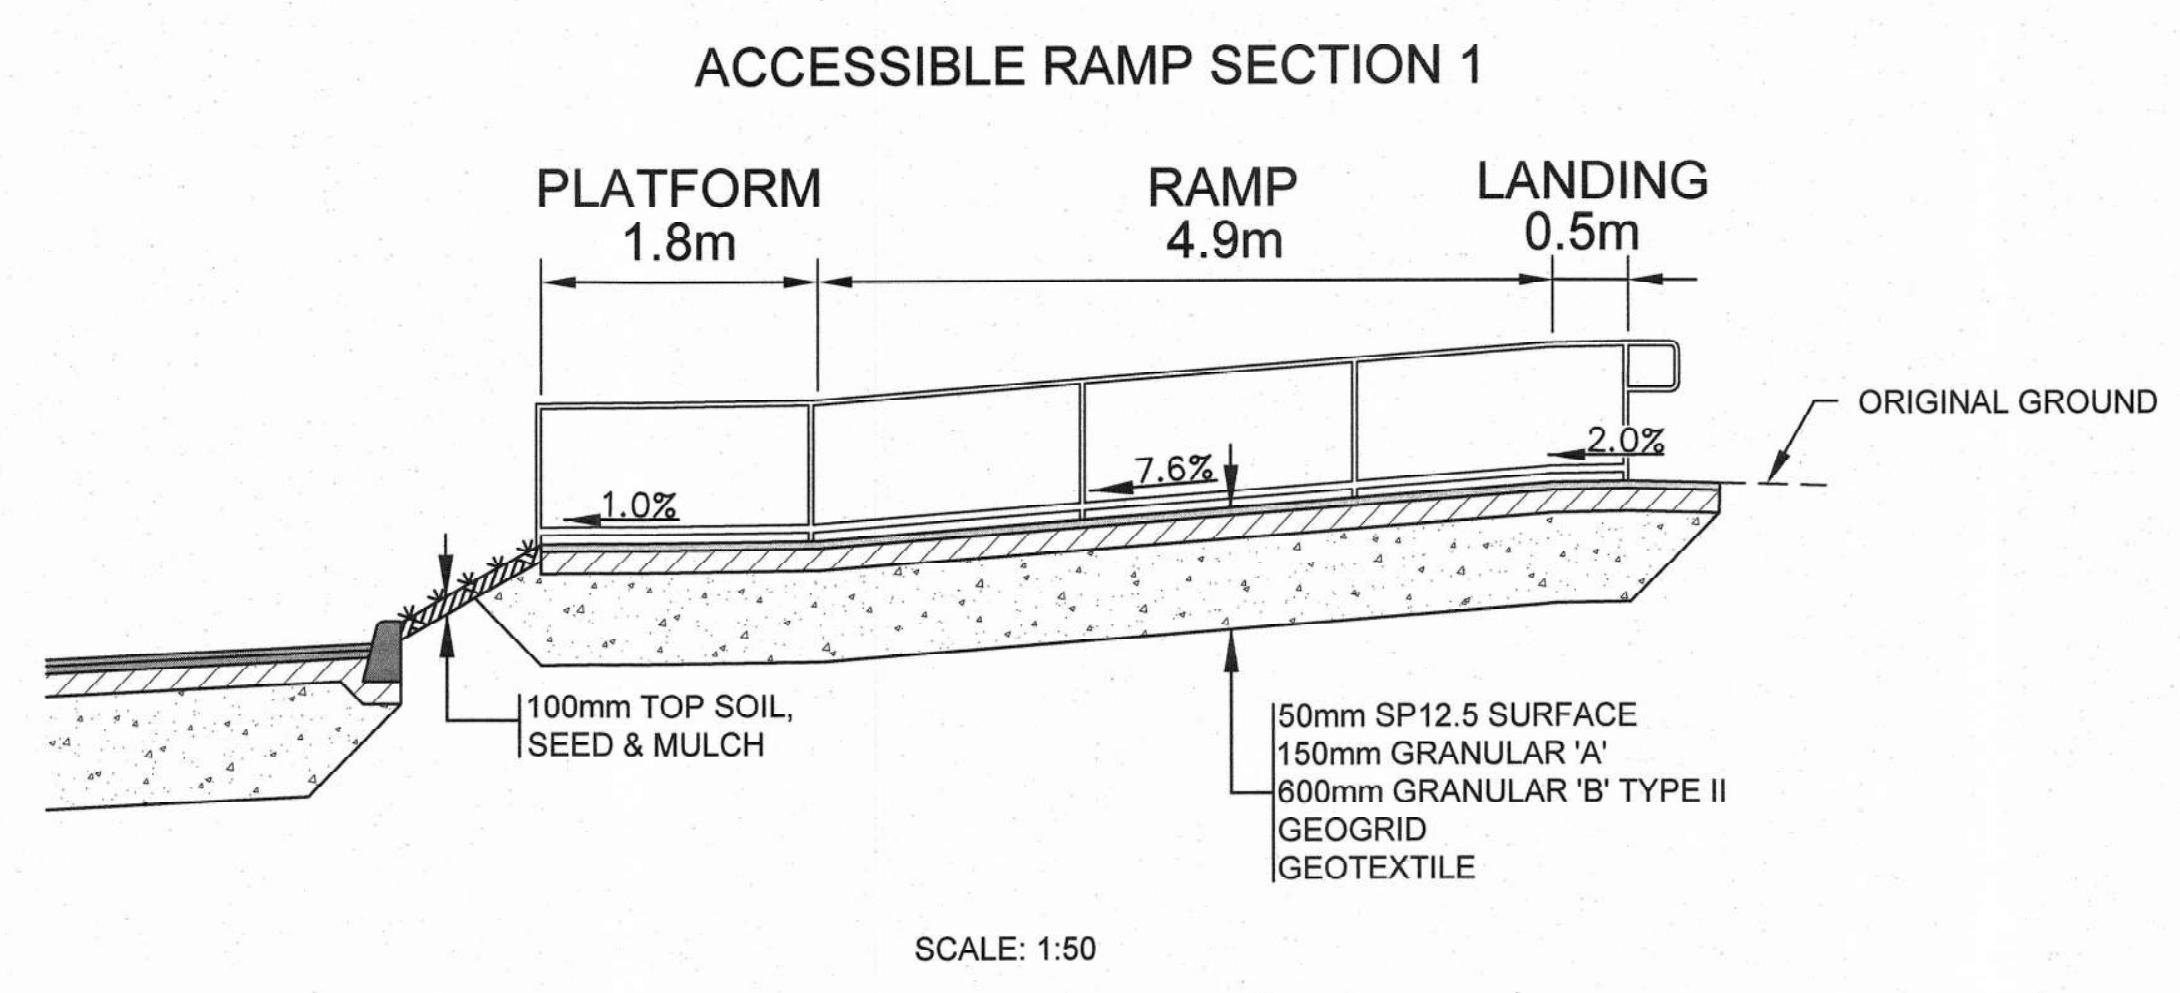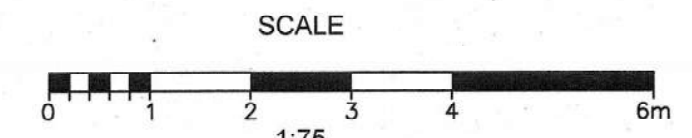

1	260622	ISSUED FOR TENDER	TAP
No.	DATE	REVISION	BY

CLIENT
ONTARIO NORTHLAND TRANSPORTATION COMMISSION

PROJECT TITLE
COCHRANE STATION PARKING LOT

PROJECT No. **NWL - 25002304-00**

DRAWING TITLE
ACCESSIBLE RAMP

	DESIGNED	SCALE
	EGL	AS SHOWN
	DRAWN	PLAN No.
	EGL	25-1298
CHECKED	DRAWING No.	
TAP	10	

EXP Services Inc.
 1-705-647-4311 | F: 1-705-647-3111
 310 Whitewood Ave. W.
 New Liskeard, ON P0J 1P0
 Canada
 www.exp.com

8:20250818 2:24:39 AM E:\ENGINEERING\PROJECT FILES\25002304-00 ONTC COCHRANE STATION PARKING LOT\EXP PROJECT FILES\25002304-00\DRAWINGS\25002304-00\COCHRANE STATION PARKING DESIGN\DWG